




GATE VALVE INSTALLATION AND BOX
(MAINS up to 300mm)

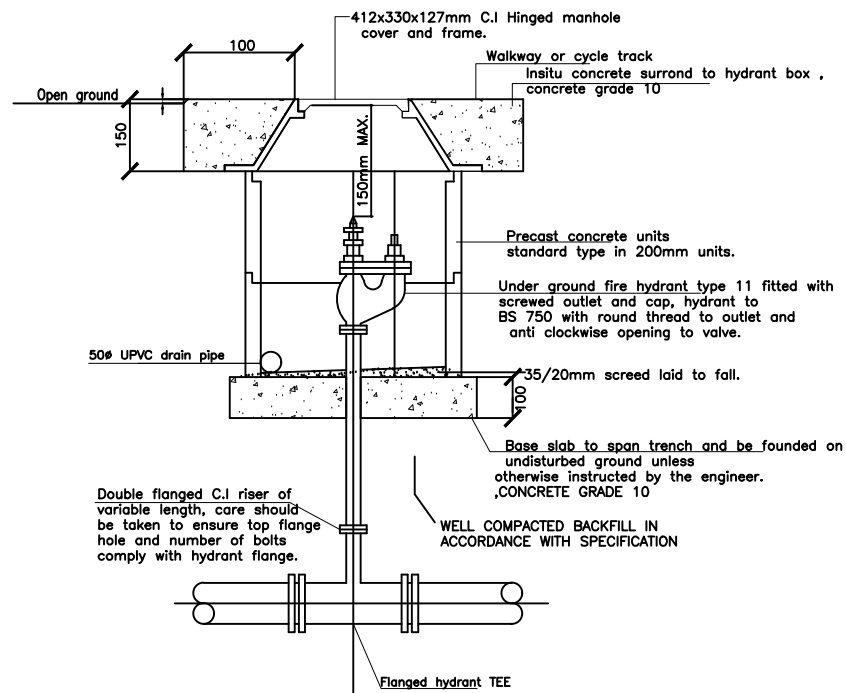


FIRE HYDRANT AND BOX DETAILS

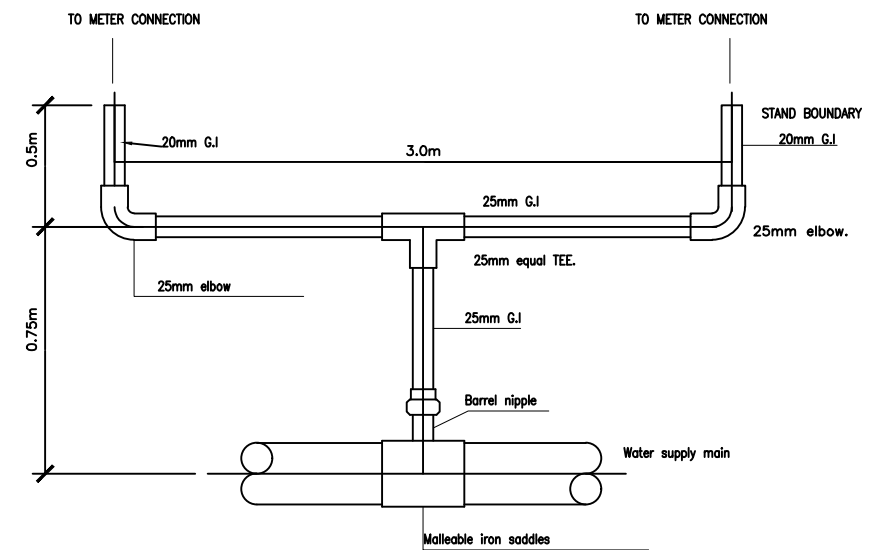


TWO WAY CONNECTION TO HOUSES

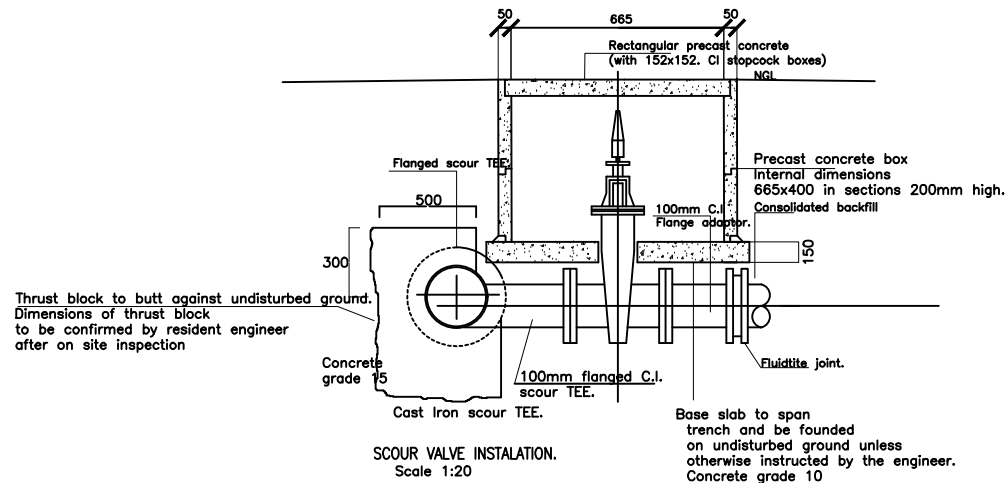


SCOUR VALVE INSTALLATION.
Scale 1:20

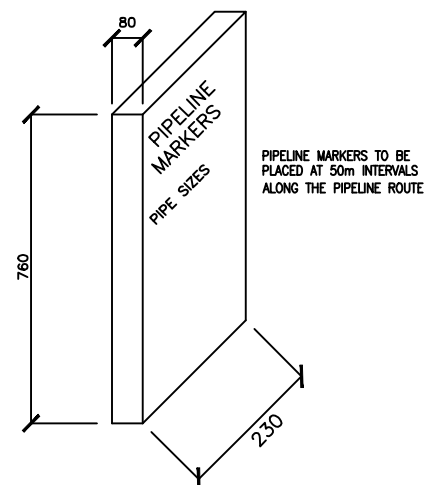


PRECAST CONCRETE PIPELINE
MAKER DETAILS

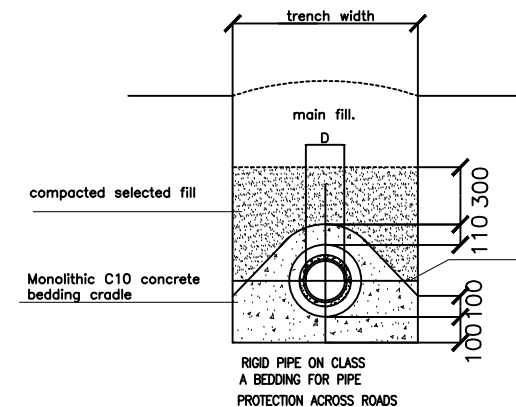



RIGID PIPE ON CLASS
A BEDDING FOR PIPE
PROTECTION ACROSS ROADS

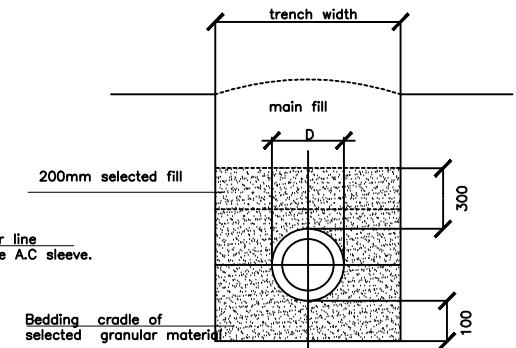

FLEXIBLE PIPE ON CLASS E BEDDING

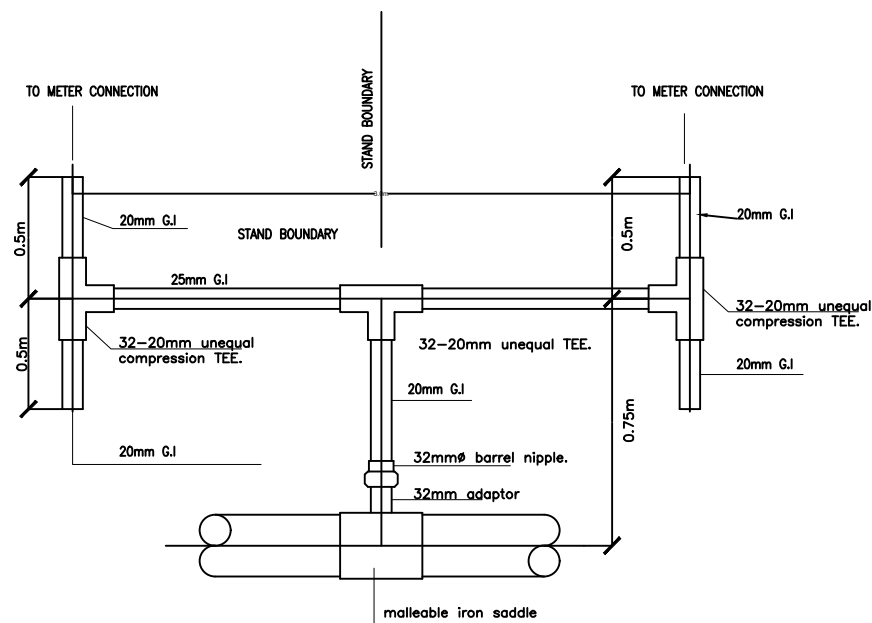

ONE WAY STAND CONNECTION

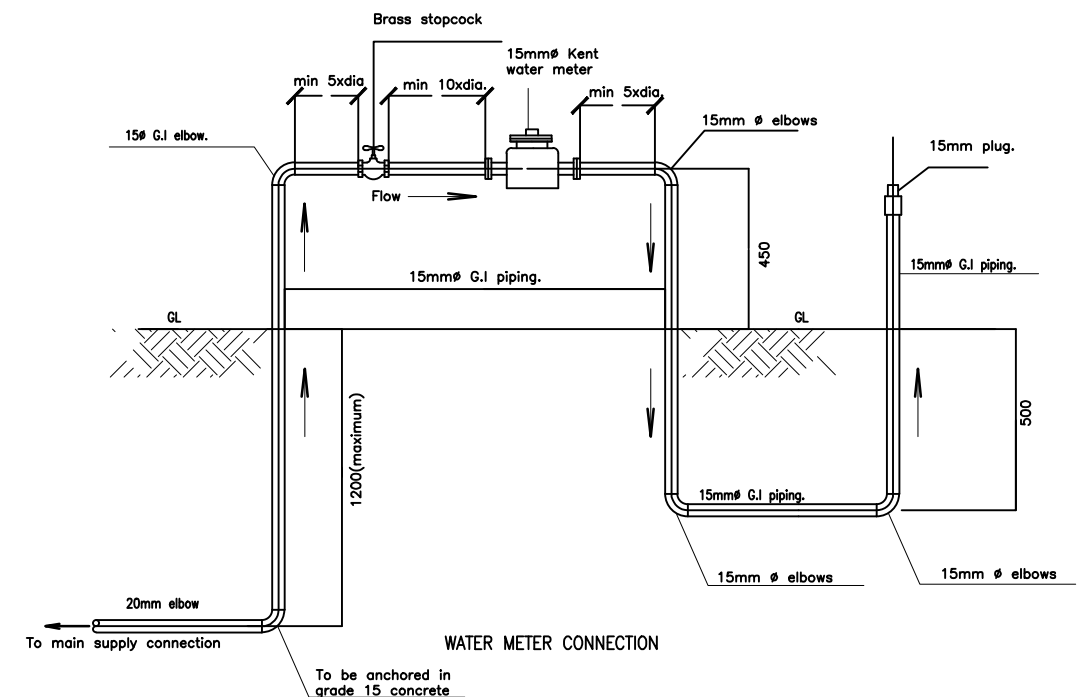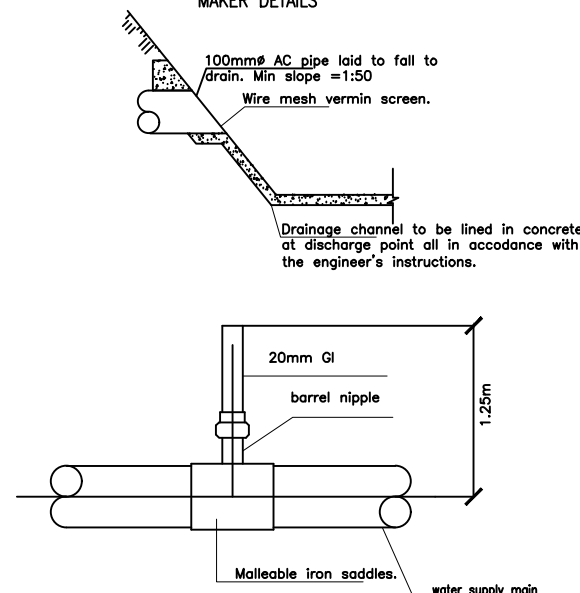

WATER METER CONNECTION

Notes

AMENDMENT		
Ltr	date	init

Micro-film
Drwg No



**MINISTRY OF
LOCAL GOVERNMENT AND
PUBLIC WORKS**
P.O. BOX CY441 , CAUSEWAY
ZIMBABWE

Branch Head : E. N
Designed : L.M
Drawn : L.M
Checked : M.M
Telephone 790137 / 704079

A/Director : E. N
Scale : NTS
Date : JANUARY 2023
File Ref

Ministry : MOHCC
Title : WATER AUGMENTATION FOR MICROBIOLOGY LABORITIES
Description : WATER STANDARD DETAILS
Details :
Stock Drwg No

Centre : BULAWAYO MPILO HOSPITAL

G.P. No
Project
No CE/02