



LOCALITY MAP

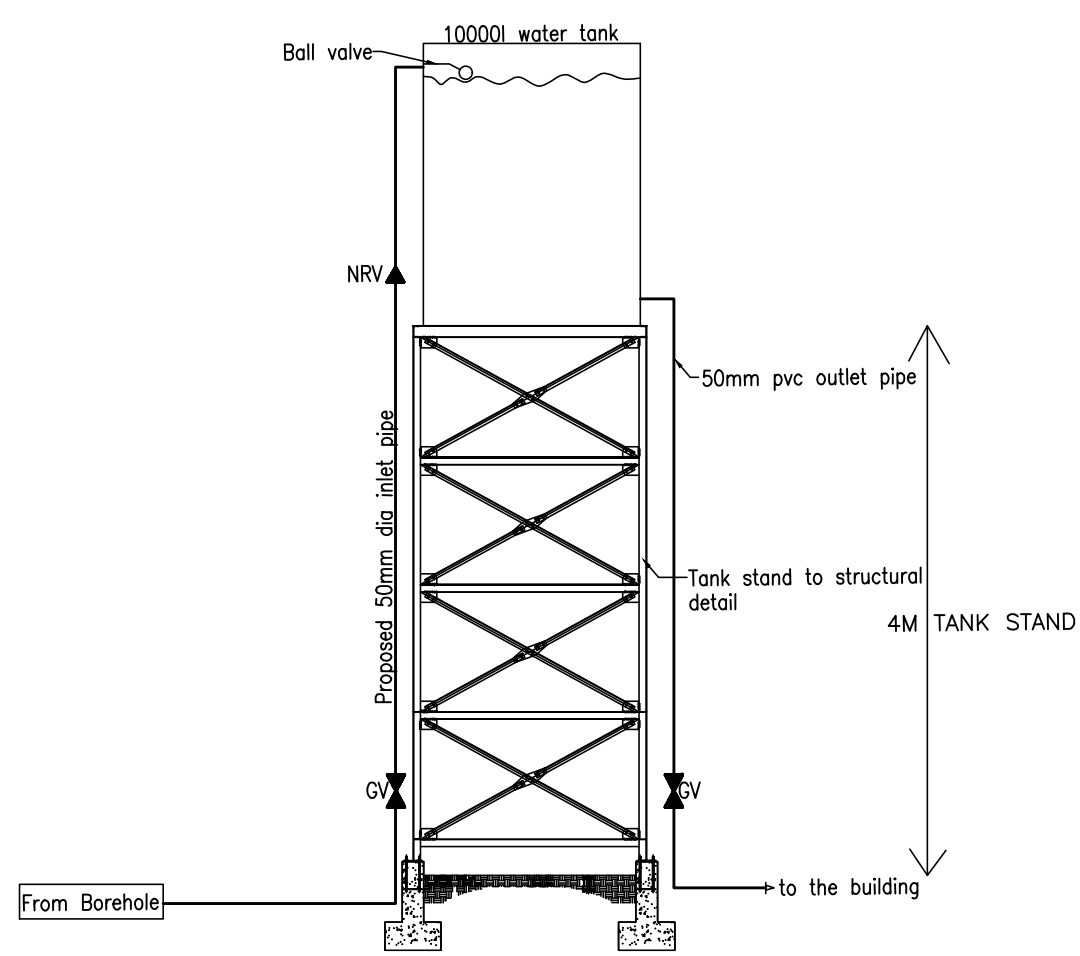

TANK CONNECTION DETAILS
DIAGRAM

LEGEND

- Scour Valve
- End Cap
- Non-Return Valve
- Gate Valve

| | | | | | | | | | | | | | | | | | | |
|-----------------------|-----------|------|------|--|--|--|--|--|--|--|--|--|--|---------------------------|---------------------|---|---------------------------------|---------------------|
| Notes | AMENDMENT | | |  MINISTRY OF LOCAL GOVERNMENT AND PUBLIC WORKS P.O. BOX CY441 , CAUSEWAY ZIMBABWE | | | | | | | | | | Branch Head : E.N | A/Director : E.N | Ministry : MOHCC | Centre : MUTARE PROVINCIAL HOSP | |
| | Ltr | date | Init | | | | | | | | | | | Designed : L.M | Scale : NTS | Title : WATER AUGMENTATION FOR MICROBIOLOGY LABORATORIES | | |
| | | | | | | | | | | | | | | Drawn : L.M | Date : JANUARY 2023 | Description : WATER RETICULATION LAYOUT FOR MUTARE GENERAL HOSPITAL MICROBIOLOGY LABORATORY | | |
| Micro-film Drwg No | | | | | | | | | | | | | | Checked : M.M | File Ref | Details : | | |
| | | | | | | | | | | | | | | Telephone 790137 / 704079 | | Stock Drwg No | G.P. No | Project No CE/16 |