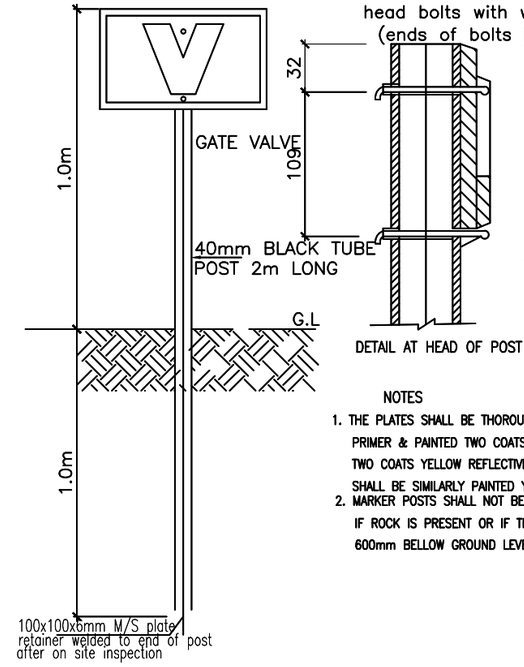

DETAILS OF HYDRANT MARKER PLATES POST

DETAIL AT HEAD OF POST

NOTES

1. THE PLATES SHALL BE THOROUGHLY CLEANED WITH A ZINC BASED PRIMER & PAINTED TWO COATS BLACK ENAMEL GLOSS FOR THE FIGURES, TWO COATS YELLOW REFLECTIVE PAINT FOR THE BACKGROUND. THE POST SHALL BE SIMILARLY PAINTED YELLOW.
2. MARKER POSTS SHALL NOT BE CONCRETED TO THE GROUND UNLESS IF ROCK IS PRESENT OR IF THE BASE OF THE POST IS LESS THAN 600mm BELLOW GROUND LEVEL THEN 0.03 Cu m OF CONCRETE SHALL BE

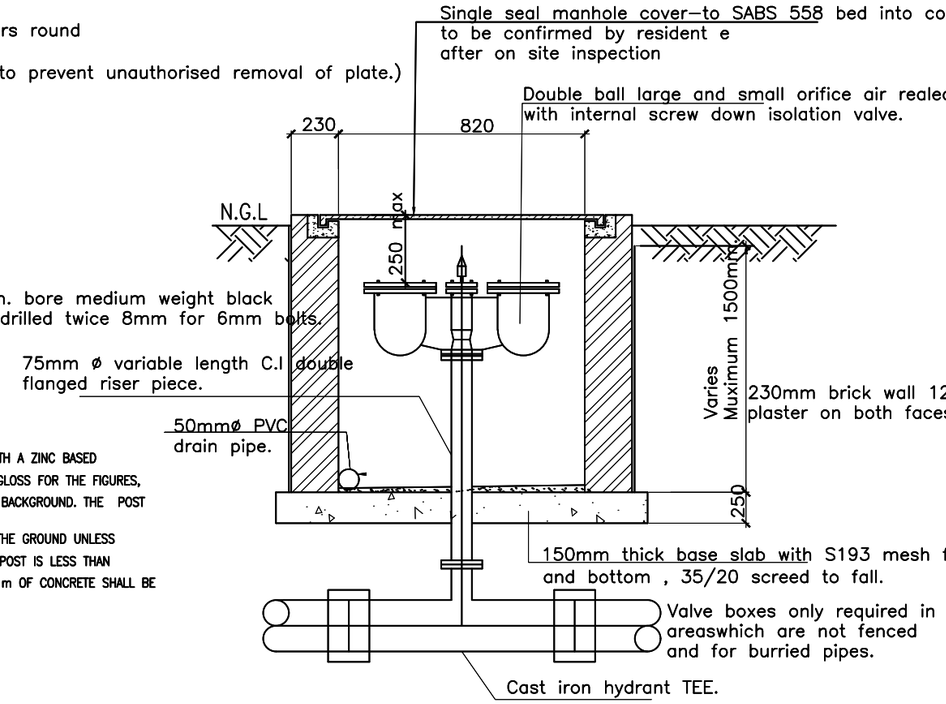

SECTION B – B

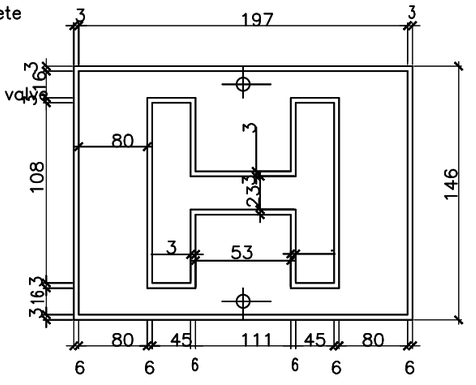

HYDRANT

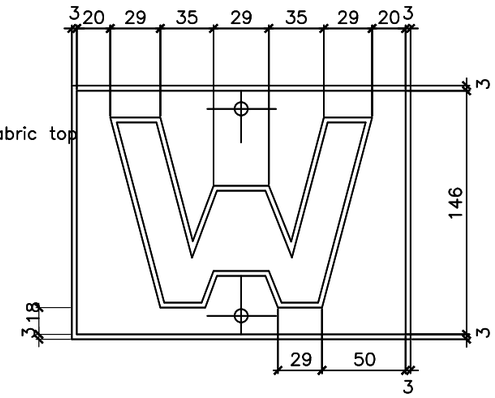

WATER METER (Reverse)

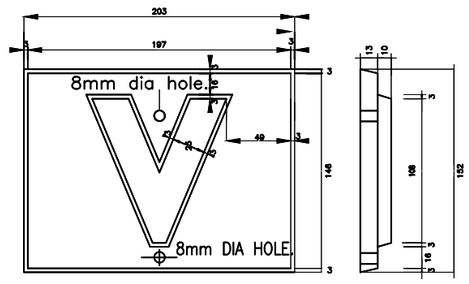

VALVE PLATE INDICATOR PLATE

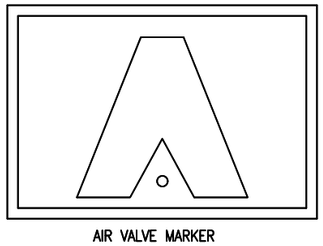

AIR VALVE MARKER

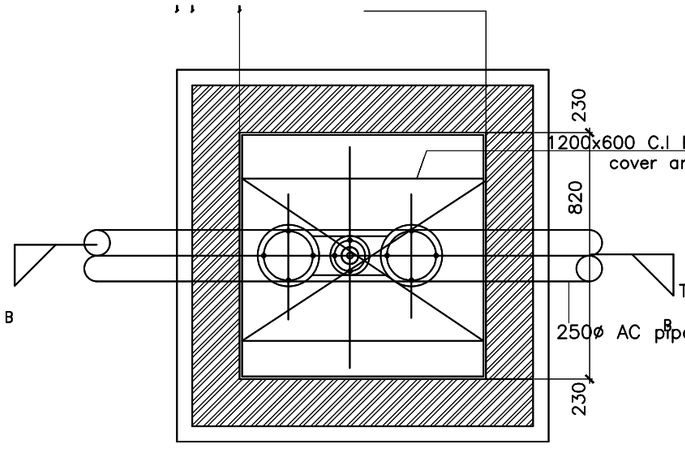

DOUBLE AIR VALVE & BOX PLAN

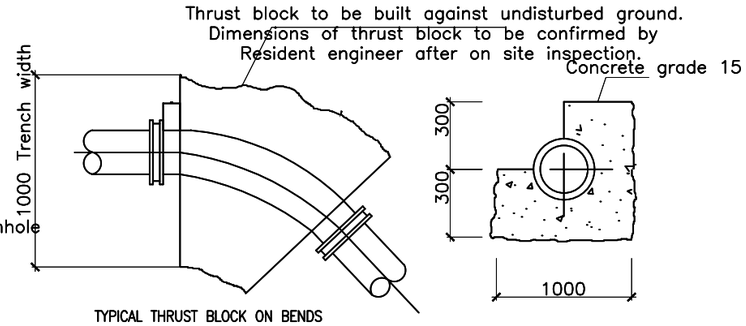

TYPICAL THRUST BLOCK ON BENDS

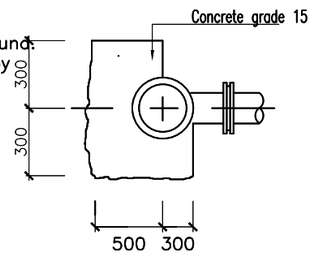



TYPICAL THRUST BLOCK AT TEE JUNCTION

Notes

AMENDMENT		
Lttr	date	Init

Micro-film Drwg No

MINISTRY OF LOCAL GOVERNMENT AND PUBLIC WORKS
P.O. BOX CY441 , CAUSEWAY
ZIMBABWE

Branch Head : E. N	A/Director : E. N	Ministry : MOHCC	Centre : BEATRICE INFECTIOUS
Designed : T. M	Scale : N.T.S	Title : WATER AUGMENTATION FOR MICROBIOLOGY LABORATORIES	
Drawn : T. M	Date : FEBRUARY 2023	Description : WATER STANDARD DETAILS 1 BEATRICE INFECTIOUS	
Checked : L. M	File Ref	Details :	
Telephone 790137 / 704079		Stock Drwg No	G.P. No / Project No